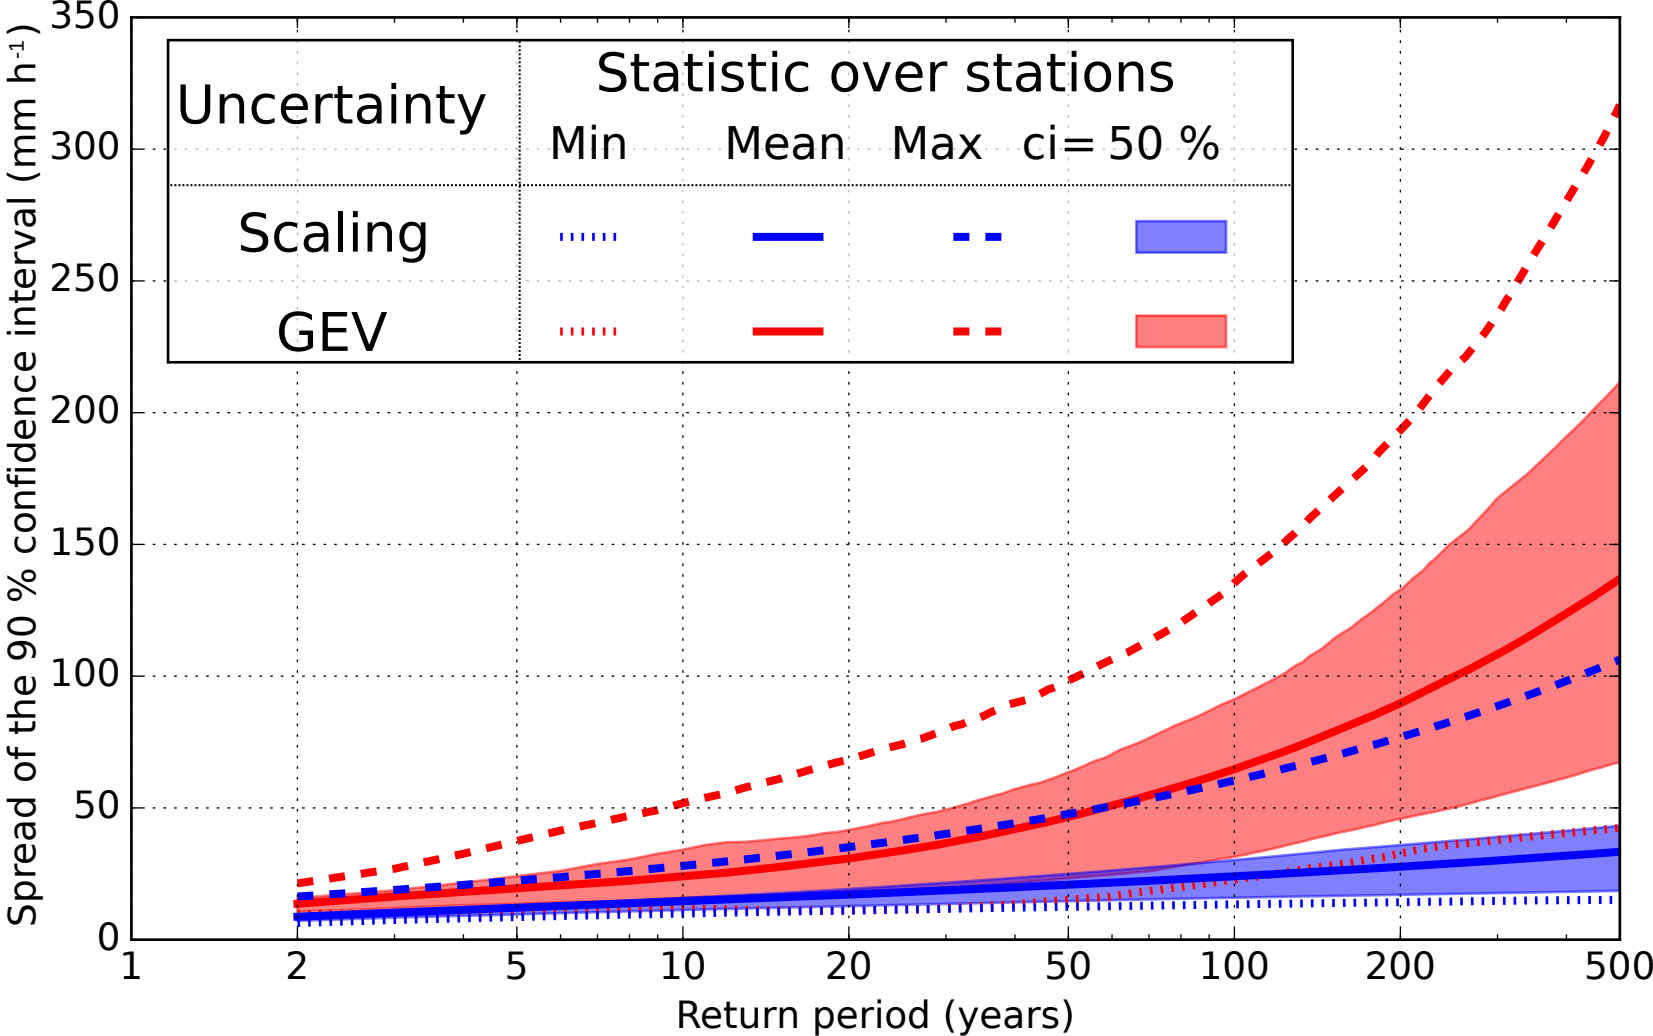
Uncertainty
Statistic over stations
Min
Mean
Max
ci= 50 %
Scaling
GEV
Spread of the 90 % confidence interval (mm h-1)
Return period (years)
0
50
100
150
200
250
300
350
1
2
5
10
20
50
100
200
500