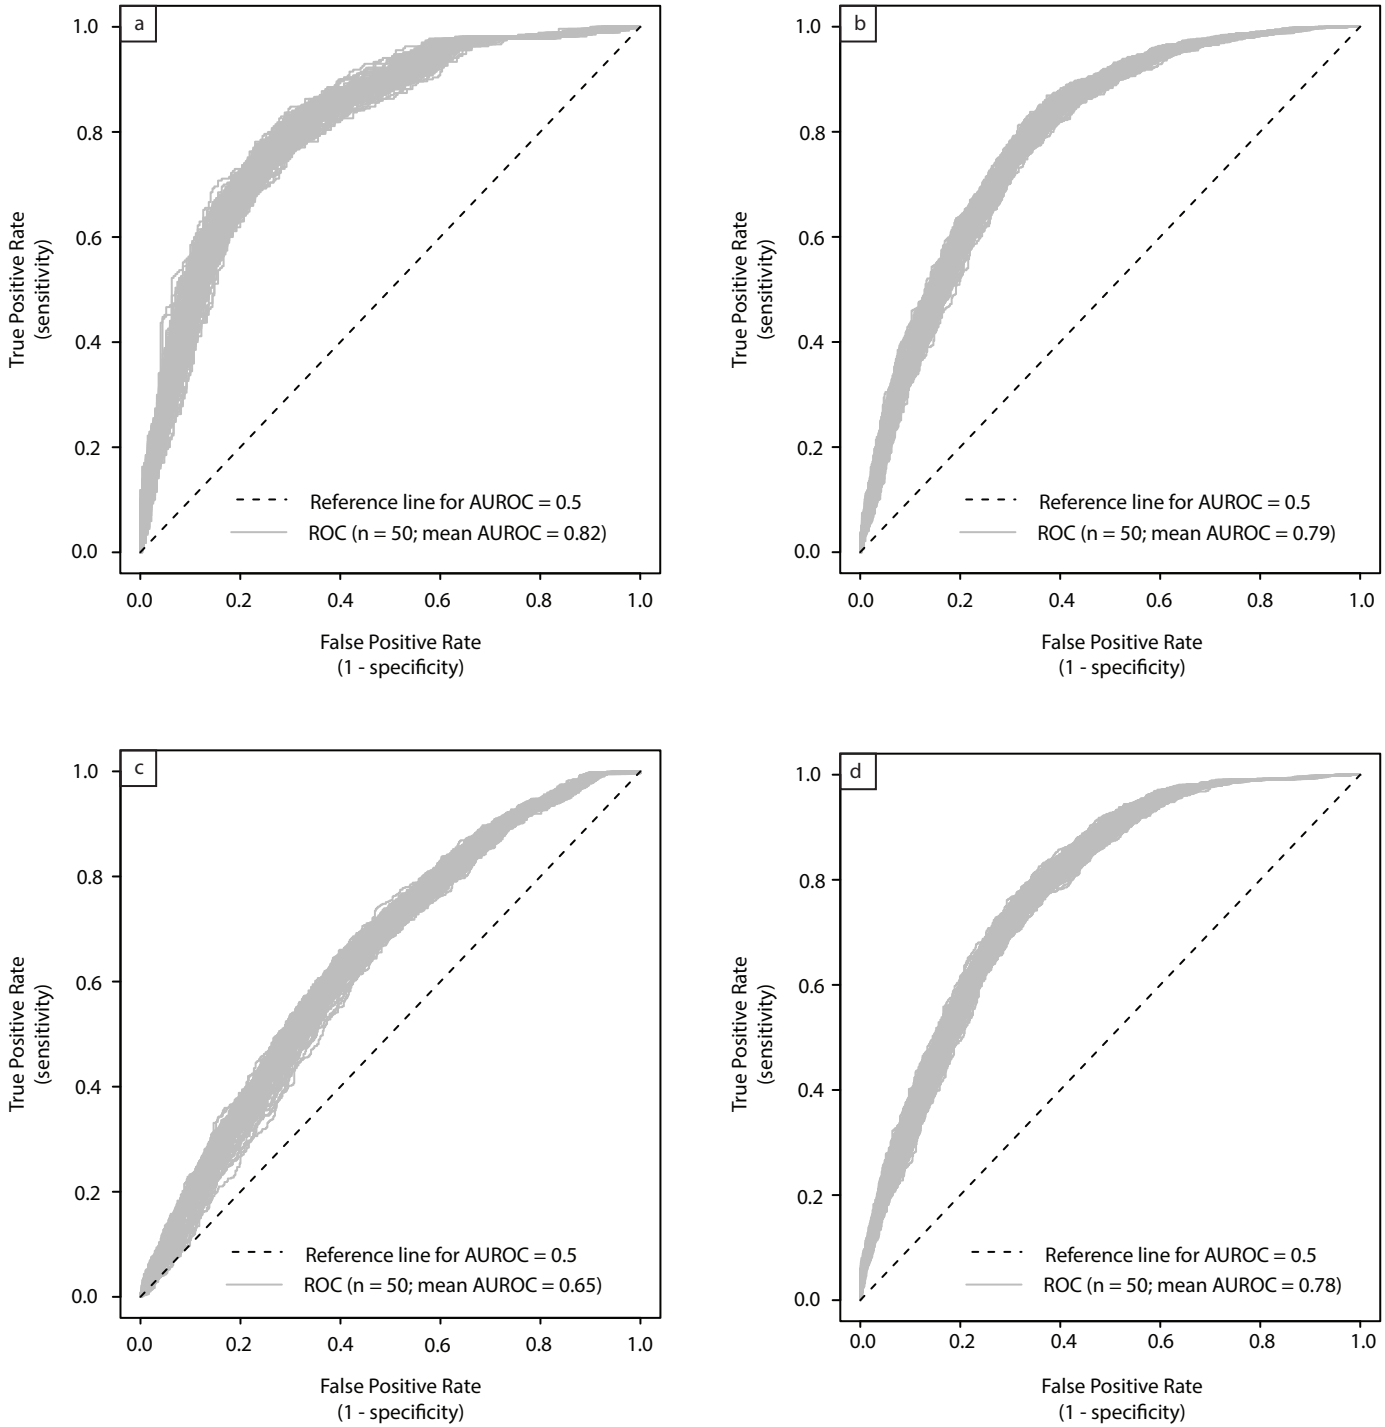
a
b
c
d
True Positive Rate
(sensitivity)
False Positive Rate
(1 - specificity)
0.0
0.2
0.4
0.6
0.8
1.0
Reference line for AUROC = 0.5
ROC (n = 50; mean AUROC = 0.82)
ROC (n = 50; mean AUROC = 0.79)
ROC (n = 50; mean AUROC = 0.65)
ROC (n = 50; mean AUROC = 0.78)