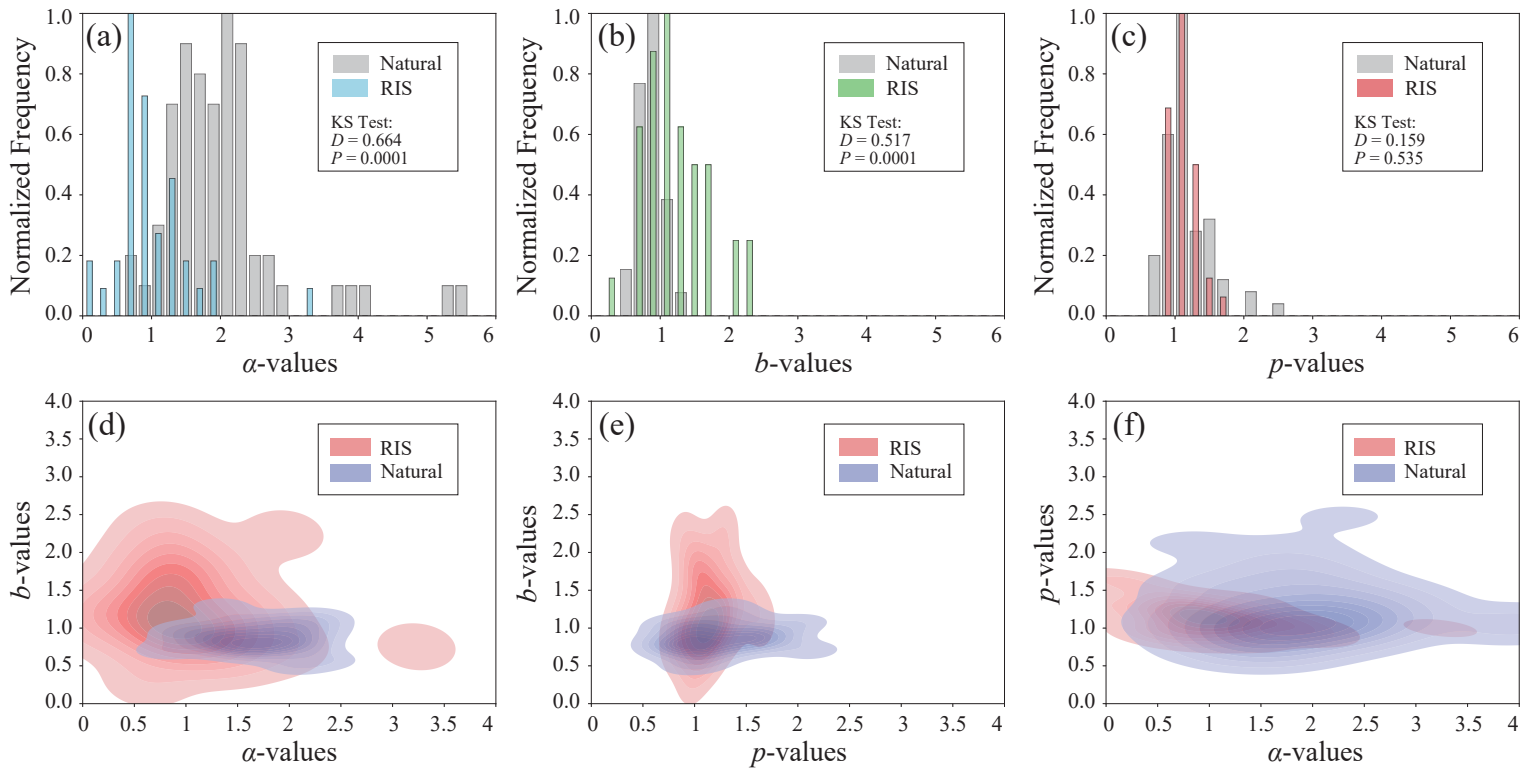

(a)
Natural
RIS
KS Test:
D = 0.664
P = 0.0001
Normalized Frequency
α-values
(b)
Natural
RIS
KS Test:
D = 0.517
P = 0.0001
Normalized Frequency
b-values
(c)
Natural
RIS
KS Test:
D = 0.159
P = 0.535
Normalized Frequency
p-values
(d)
RIS
Natural
b-values
α-values
(e)
RIS
Natural
b-values
p-values
(f)
RIS
Natural
p-values
α-values